



SECCION HORIZONTAL

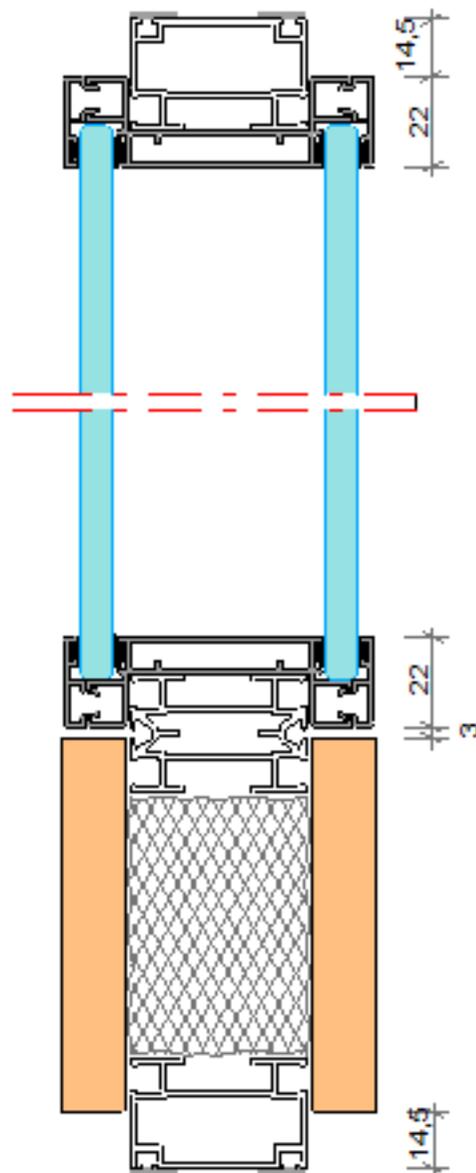

SECCION VERTICAL

Frecuencia f Hz	R (1/3 de octava) dB
50	--
63	--
80	--
100	26,8
125	35,1
160	37,9
200	39,2
250	30,9
315	32,9
400	37,8
500	36,8
630	36,2
800	38,6
1000	46,7
1250	46,2
1600	40,6
2000	38,0
2500	40,0
3150	47,0
4000	51,7
5000	51,6

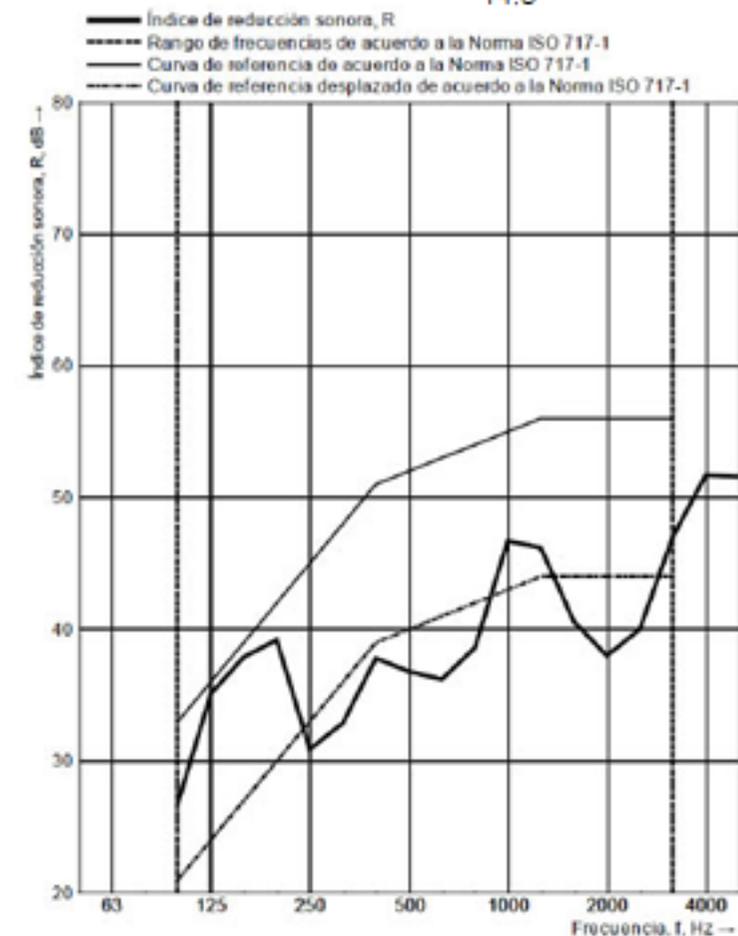

Valoración de acuerdo a la Norma ISO 717-1

$R_w(C;Ctr) = 40 (-1; -2) \text{ dB}$

Evaluación basada en resultados medidos en laboratorio obtenidos mediante un método de ingeniería

$C_{50-3150} = -$ $C_{50-5000} = -$ $C_{100-5000} = 0 \text{ dB}$
 $C_{tr,50-3150} = -$ $C_{tr,50-5000} = -$ $C_{tr,100-5000} = -2 \text{ dB}$



DIVISORIA
T82 - serie 22

M. Huelva

16/01/17

ESCALA